



Gas sensor KSE 684 for detection of Nitrogen Dioxide NO₂



Mode of operation

Through the diffusion of nitrogen dioxide NO₂ into the inside of the measurement cell, a reaction with the electrode will take place. The product at the working electrode then oxidises. The oxygen molecule used for this is replaced from the ambient air. This results in the very long service life of the measurement cell, which, from experience, can operate for several years..

The measured gas concentration is linear to the electrical output signal of the gas measurement probe. The potentiometers and the 3.5 mm jack connection for the calibration are accessible from the outside, and permits a "one-man" calibration.

When used in a pump system, the service life can be heavily reduced, as the electrolyte evaporates more quickly through the porous diaphragm. The measurement cell is sensitive to solvent vapours.

The **calibration gas** should be 75% of the measurement range, and must contain synthetic air as the carrier gas.

Performance Characteristics

Sensitivity:	at least 0,1 ppm
Measuring range:	max. 20 ppm / linear
Standard calibration:	0...10 ppm/ 0...20 ppm
Response time t_{90} :	max. 60 sec
Operating temperature:	-20 °C ... +50 °C
Start up after reconditioning:	max. 1 h
Pressure range:	atmospheric \pm 10%
Air humidity:	15...90% non condensing
Position sensitivity:	none
Long term output drift:	< 2% / moth
Life span at 20 °C:	at least 1 year depends on the application

Cross sensitivity to other gases

Test gas	concentration of the test gas	display on the NO ₂ -Sensor
Chlorine Cl ₂	10 ppm	-8 ppm
Ethylene C ₂ H ₄	100 ppm	0 ppm
Carbon Monoxide CO	300 ppm	0 ppm
Sulphur Dioxide SO ₂	5 ppm	0 ppm
Nitric Oxide NO	35 ppm	0 ppm
Hydrogen H ₂	300 ppm	20 ppm


Sensor electronic specification

Cable:	2-core cable, shielded
Power supply:	13.5...30 VDC
Sensor current:	max. 60 mA
Output signal:	4...20 mA/ max. 60 mA
Operating temperature:	-40 °C ... +85 °C

Inspection (Maintenance)

The sensor and the electronic require an inspection.
Routine calibration is recommended once or twice a year.

Electronic

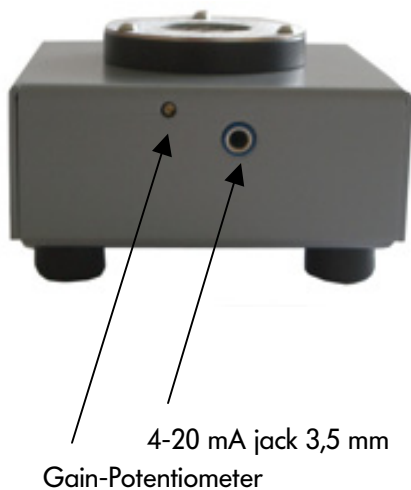

Dimensions

